



Livi FS smoke sensor manual

DESCRIPTION


The Livi FS smoke sensor (hereafter referred to as the sensor) is designed for early fire detection. The sensor operates according to the scattered light method.

The sensor has a smoker warning mode (warning on increase in the smoke concentration).

The sensor switches to the alarm mode if it detects smoke:

1. the sensor triggers an acoustic alarm, the sensor indicator starts blinking red;
2. the sensor sends an alarm alert to the [Livi Smart Hub](#) (hereafter referred to as the hub).

SENSOR APPEARANCE

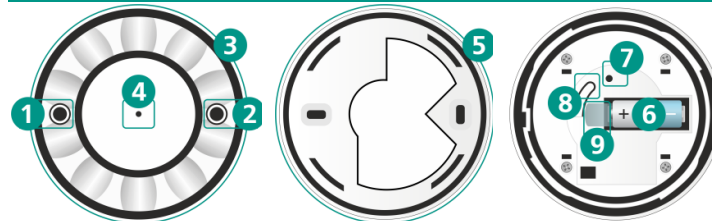

1. Operation mode indicator
2. Connection indicator
3. Enclosure lid
4. Smoke chamber access hole
5. Ceiling mounting bracket
6. Main battery
7. Operation check button
8. Tamper button
9. Protective film

BINDING THE SENSOR TO THE HUB

The sensor must be unpacked and allowed to reach room temperature for at least two hours before handling if it was transported or stored at low temperatures.

1. Open the sensor enclosure: hold the ceiling mounting bracket and turn the enclosure lid anticlockwise.
2. Pull the protective film out of the main battery compartment. The operation mode indicator will start blinking red once the sensor is switched to the binding mode.
3. [In the Livicom app](#), open the "Devices" screen. In the upper right corner of the screen tap **+** and select "Add Device". The connection indicator will blink green 5 times after successful binding.

The sensor switches to the binding mode only for 60 seconds. If you have not bound it to the hub within this period, remove the main battery from the sensor for 30 seconds, and reinstall it (observing polarity). The sensor will switch to binding mode again.

CHOOSING A LOCATION FOR THE SENSOR

We recommend installing the sensor on the ceiling at the highest point of the room (optimally in the center of the room). **DO NOT** install the sensor:

- outdoors,
- at a distance of less than 0.5 m to the nearest corner of the room (for example, in niches, near the top of an A-shaped roof),
- in places with a high content of dust or suspensions of building materials in the air, as well as in places of smoke (for example, in smoking areas),
- in places with intense airflow (e.g. near fans, radiators, and air ventilation ducts),
- in places with high humidity, or at temperatures exceeding the operating temperature range (see "Specifications" table below).

EVALUATING SIGNAL STRENGTH


Check the quality of the connection between the sensor and the hub at the intended location of the sensor. There are two ways to evaluate the signal strength:

1. In the Livicom app, on the sensor settings screen.
2. With the help of the LED indication on the sensor. Double-click on the tamper button and look at the sensor indicators. Interpret the indication using the table below.

Good signal	The connection indicator blinks green 3 times
Average signal	The connection indicator blinks green twice
Poor signal	The connection indicator blinks green once
No connection	The operation mode indicator blinks red 4 times

SENSOR INSTALLATION

Open the sensor enclosure (if it is closed): hold the ceiling mounting bracket (5) and turn the enclosure lid anticlockwise. Fasten the ceiling mounting bracket at the selected location with two screws from the supplied mounting kit. Close the sensor enclosure: align marks on the enclosure lid and the ceiling mounting bracket, and then turn the lid clockwise to fasten the sensor.



CHECKING THE SENSOR OPERATION

Check the operation of the sensor after its installation. There are three ways to simulate an alarm for the sensor:

1. Spray a special test aerosol.
 2. Immerse a thin metal wire in the smoke chamber through the hole in the sensor enclosure (4). Hold the wire in the smoke chamber until the sensor triggers an acoustic alarm and the operation mode indicator starts blinking red.
 3. Press the operation check button (7). Use a paper clip to press the button and hold it until a sound and LED notification appear (at least 5 seconds).
- The sensor operates properly if an acoustic alarm sounds continuously and the operation mode indicator blinks red. Contact technical support (mail to: support@livicom.ru) if you see an incorrect indication or do not receive the "Fire" alert in the Livicom app.

SENSOR MAINTENANCE

Keep the sensor free of dust and dirt. Replace the battery as soon as possible after you receive a "low battery" notification in the Livicom app. Dust removal must be performed at least once a year and as soon as possible after you receive a "smoke chamber cleaning required" notification in the Livicom app. Blow out the smoke chamber with compressed air (for example, with the help of a compressor) to remove dust, and wipe the sensor enclosure with a wet tissue.

Attention

Do not wipe the sensor with substances containing alcohol, acetone, gasoline and other active solvents

REPLACING THE BACKUP BATTERY

1. Open the sensor enclosure and remove the 4 screws located around the main battery compartment. Be careful when working with screws to avoid splines and threads in the plastic.
2. Remove the enclosure lid, unbend retaining clips and pull out the sensor.
3. Remove the battery and install a new CR2032 battery, observing polarity.
4. Reassemble the sensor by following the above steps in reverse order.

DELETING THE SENSOR (UNBINDING FROM THE HUB)

There are two ways to unbind the sensor from the hub:

1. In the Livicom app, on the sensor settings screen.

2. Using the tamper button (8). Remove the main battery from the sensor for 30 seconds, then press the tamper button and while holding it, reinstall the main battery, observing polarity. Release the tamper button and quickly click on it until the operation mode indicator starts blinking red.

SPECIFICATIONS

Operating frequency	868 MHz
Sensor sensitivity	0,05-0,2 dB/m
Guaranteed operating range in open areas	up to 1000 m
Radio channel power	25 mW
Permissible ambient lighting	up to 12 000 lx
Fire alarm volume level	70 dB
Recovery period after an alarm (if no more smoke is detected)	1 minute
Current consumption in sleep mode	8 µA
Current consumption in operation mode	up to 30 mA
Main power source (3 V)	battery CR123A
Backup power source (3 V)	battery CR2032
Main battery life	10 years
Backup battery life	2 months
Operating temperature range	from -20 to +55 °C
Relative humidity	no more than 80% at 25 °C
Dimensions	110 x 110 x 58 mm

SUPPLY SET

Livi FS smoke sensor	1
Mounting kit	1
Lithium battery CR123A (3 V)	1
Lithium battery CR2032 (3 V)	1
Protective film for the battery	1
Packaging	1

SOUND AND LED INDICATION

Smoker warning mode (warning on increase in the smoke concentration)	Repeating short beeps
Alarm mode (sending "Fire" alert to the Livicom app)	Acoustic alarm lasts from 1 to 5 minutes
	The operation mode indicator blinks red during acoustic alarm
Binding mode	The operation mode indicator blinks red for 1 minute
Return to normal state	The connection indicator blinks green once
Confirmation of successful binding	The connection indicator blinks green 5 times
Enclosure of the sensor is open	Short double beep

WARRANTY

The manufacturer LLC "NPP Stels" guarantees that the sensor meets AGNS.425449.001 TU technical requirements, provided that the consumer complies with the conditions of transportation, storage, installation and operation. The warranty period is 5 years from the manufacturing date. The warranty does not apply to batteries.

The warranty does not cover the following cases:

1. Non-compliance with the intended operating conditions;
2. Mechanical damage to the sensor;
3. Repairs to the sensor by a third party (a person or a company other than the Manufacturer).